


SEDM EI 120 S (In Horizontal Duct)

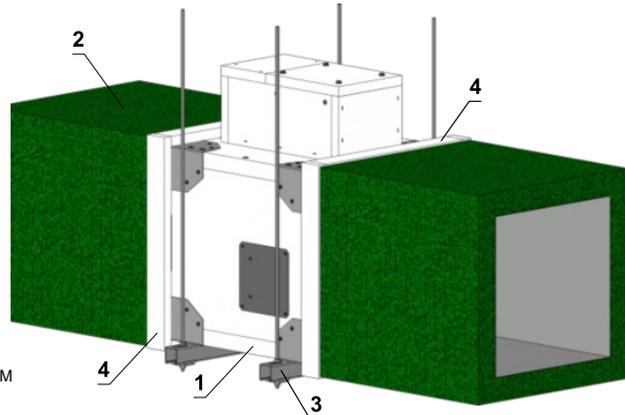


Position:

- 1 SEDM
- 2 Duct
- 3 Fixing profile with threaded rod
- 4 Connections insulation

The dampers must be suspended using threaded rods and mounting profiles. Their dimensioning depends on the damper's weight.

The dampers and duct must be suspended separately. The connected duct must be suspended in such a way that the transfer of all loads from the adjoining ventilation duct to the damper body is completely excluded. Adjacent duct must be suspended or supported, as required by the duct suppliers.

Threaded rods longer than 1.5 m must be protected by fire insulation.

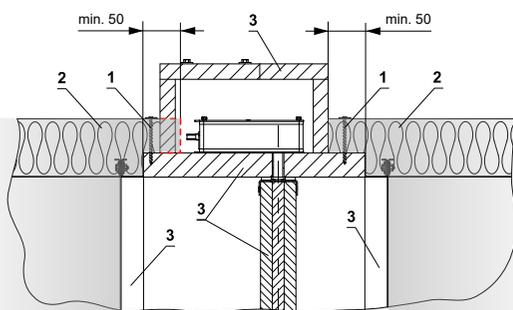


Duct from sheet metal thickness 1,2 mm with insulation ROCKWOOL FIREPRO
DuctRock Slab thickness 90 mm acc. to EN 1366-8

Damper SEDM

Duct from sheet metal thickness 1,2 mm with insulation ROCKWOOL FIREPRO
DuctRock Slab thickness 90 mm acc. to EN 1366-8

Insulation cut-out area around the actuator cover

*For blade overlap dimension see full TPM.

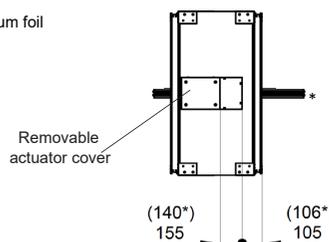


Connect the joints of stone wool plates with ROCKWOOL Glue, secure with nails and welding pins at max. spacings of 250mm. Board joints must be covered using ROCKWOOL black aluminium foil tape. Follow duct supplier's instructions and insulation.


Position:

1. Universal screw min. Ø5 mm, length 70 mm, max. spacing 250 mm
2. ROCKWOOL FIREPRO DuctRock Slab th. 90 mm acc. to EN 1366-8
3. Part of SEDM
4. Welding pins at max. spacings of 250 mm

Drop rod and hanger location, please ensure that actuator operation is not compromised and ensure sufficient space to allow access hatch removal.

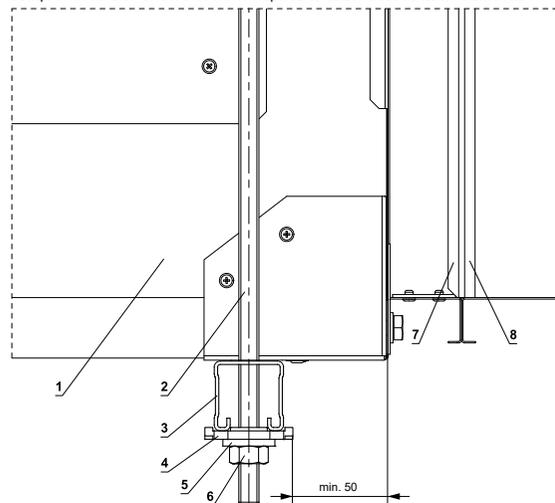


Drop rod and hanger position is not critical and can be positioned to suit the particular installation, applying symmetry where possible.


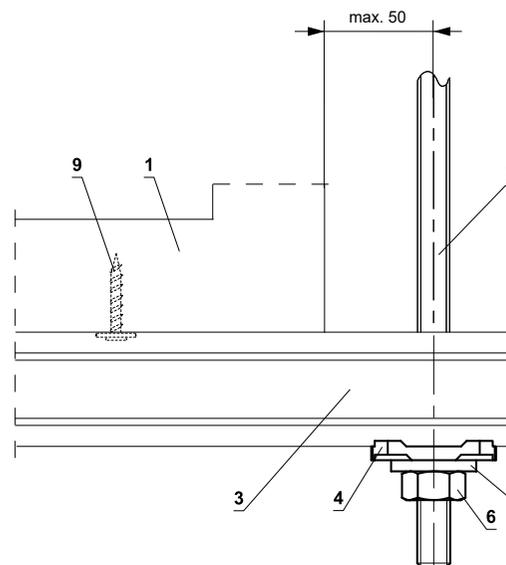


- 1 SEDM
- 2 Threaded rod M8 - M20
- 3 Support HILTI MQ-41 (or MQ-41/3 or equivalent)
- 4 Bored plate HILTI MQZ-L or equivalent
- 5 Washer for M8 - M20
- 6 Nut M8 - M20
- 7 Flange of SEDM
- 8 Flange of duct
- 9 Self-tapping screw 5x30 mm and 1 pcs large washer M5 (for additional fixing, prevents the damper from sliding off the support - not necessary use)

Advice provided by a fixing specialist contractor takes precedence.

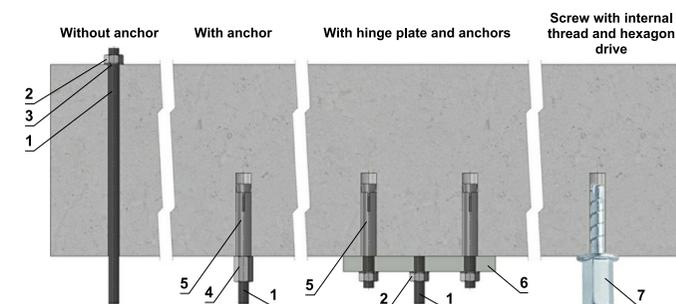

Hinge plates

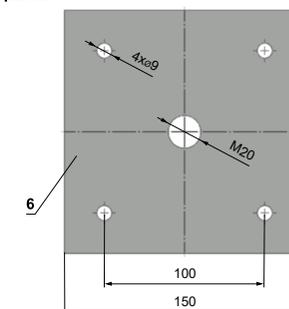

If in doubt then always consult a specialist anchor engineer such as Halfen or Hilti.

Position:

- 1 Threaded rod M8 - M20
- 2 Nut M8 - M20
- 3 Washer for M8 - M20
- 4 Coupling Nut M8 - M20
- 5 Anchor
- 6 Hinge plate - min. thickness 10 mm
- 7 Concrete screw tested for fire resistance R30-R90, max. Tension up to 0.75kN (length 35mm)

Load capacities of threaded hanger rods F [N] at the required fire resistance 90 minutes

Size	A _s [mm ²]	Weight G [kg]	
		for 1 piece	for 1 pair
M8	36,6	22	44
M10	58	35	70
M12	843	52	104
M14	115	70	140
M16	157	96	192
M18	192	117	234
M20	245	150	300

Drop rod diameter is based on damper weight, see full Damper TPM for further technical details or contact help@Mandik.co.uk. Mandik reserves the right to update this information without prior notice.

		Mandik UK Ltd www.mandik.co.uk Office: 0117 4526376	130 Aztec West Park Avenue Bristol BS32 4UB
		UKCA certified acc. to EN 12101-8	
Title:		SEDM - In Horizontal Duct	
Classification:		EI 120 (hod-ved i<->o) S1000CmodHOT 400/30MAmulti	
Drawing No:		0000-0000-551 Rev 2	
Date:		03/07/2023	
Illustrated:		AA	Approved: MF
Intellectual property of MANDIK Ltd. Unauthorised use shall be punishable by law			