
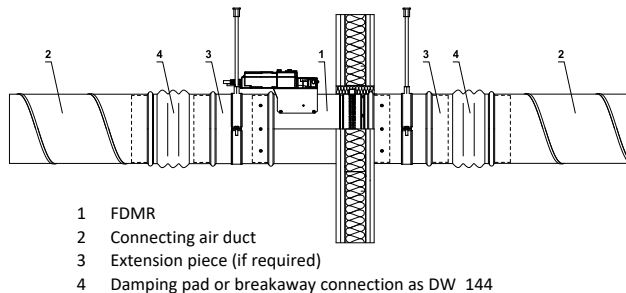


FDMR - Gypsum Wall - Mortar or Gypsum - EI 120 (v_e i↔o) S* / EI 90 (v_e i↔o) S - UKCA



Duct Connection

Advice provided by a fixing specialist contractor takes precedence.

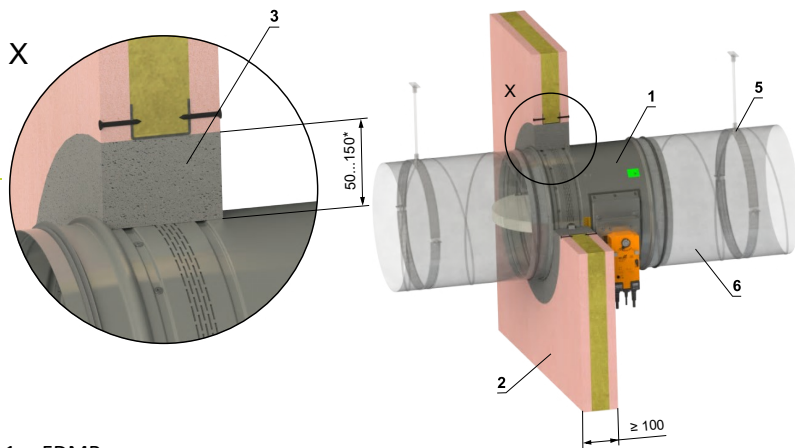

- 1 FDMR
- 2 Connecting air duct
- 3 Extension piece (if required)
- 4 Damping pad or breakaway connection as DW 144

Placing of mounting brackets In gypsum wall construction

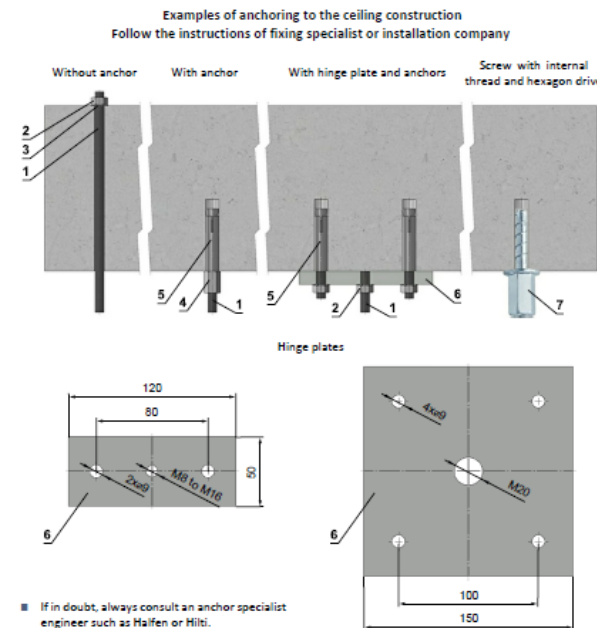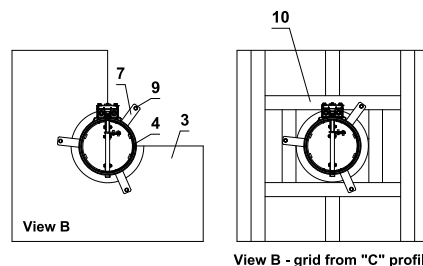



- 1 FDMR
- 2 Gypsum wall construction
- 3 British gypsum thistle bond 60 (or equivalent can by used) minimum density 670 kg/m³
- 4 Damper bracket
- 5 Circular suspension with threaded rod
- 6 Duct

FFDM or alternative breakaway joint must be used either side of the damper.

Wall build construction must be symmetrical and in accordance with BS EN 1363-1 and tested in accordance with BS EN 1364-1.

Blade overlaps must be accounted for to ensure blade operation is not compromised. For full blade overlap dimensions please see product TPM.

Damper must be installed to built in edge shown by orange label on the damper

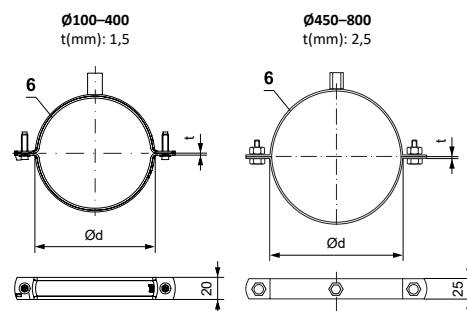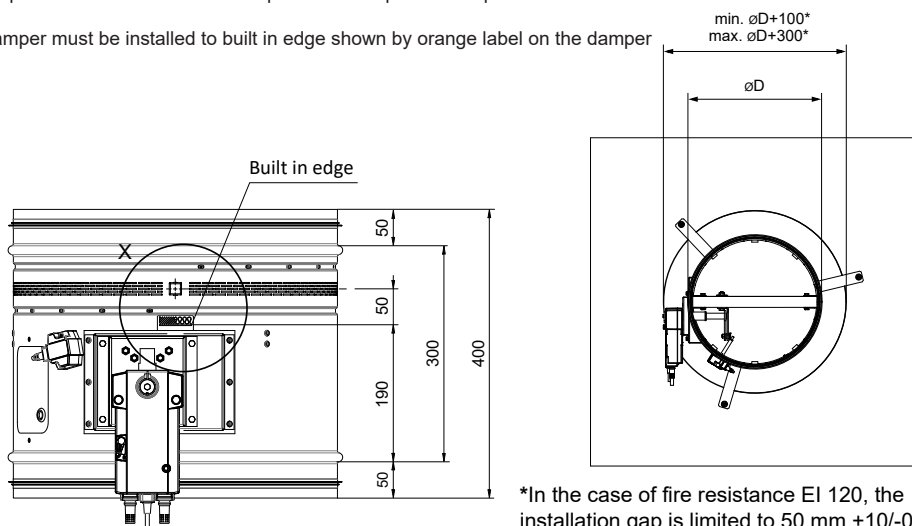

Ø100-400
With slotted quick closure.
With screw M6x20 and head: hex 1/4" and PH2.
Connection nut M8+M10.

Ø450-800
With Ø 10 hole.
With bolt and nut H17 M10x30.
Connection nut M8+M10.

- 3 Gypsum wall construction
- 4 FDMR
- 6 Circular suspension with threaded rod
- 7 Damper bracket
- 8 M8 anchor with nut
- 9 Screw with hexagon head M8x45 mm
- 10 Gypsum grid from "C" profile

*In the case of fire resistance EI 120, the installation gap is limited to 50 mm +10/-0. For fire resistance EI 90 or lower, an installation gap range of 50-150 mm is permitted.

- 1 Threaded rod M8 - M20
- 2 Nut M8 - M20
- 3 Washer for M8 - M20
- 4 Coupling Nut M8 - M20
- 5 Anchor
- 6 Hinge plate - min. thickness 10 mm
- 7 Concrete screw tested for fire resistance R30-R90, max. tension up to 0.75KN (length 35mm)

Load capacities of threaded rods at the required fire resistance 60 min. < t ≤ 120 min.

Size	As [mm²]	Weight [kg]	
		for 1 rod	for 2 rods
M8	36,6	22	44
M10	58	35	70
M12	84,3	52	104
M16	157	96	192
M18	192	117	234
M20	245	150	300

Drop rod diameter is based on damper weight, see full Damper TPM for further technical details or contact technical@Mandik.co.uk. Mandik reserves the right to update this information without prior notice.

MANDIK®

Mandik UK Ltd
www.mandik.co.uk
Office: 0117 4526376

2440 The Quadrant
Aztec West
Bristol
BS32 4AQ

Title: **FDMR - Gypsum wall - Gypsum/Mortar**

UKCA certified acc. to EN 15650

Classification: **EI 120 (v_e i↔o) S**

Tested in accordance with EN 1366-2

Drawing No: **0000-0000-320 Rev 5**

Size: (min-max) **100Ø-800Ø**

Date: **25/08/2026**

Illustrated: **AA** Approved: **MF**

Intellectual property of MANDIK Ltd. Unauthorised use shall be punishable by law